

- 7 functions
- 10 time ranges
- Connection of remote potentiometer possible
- Zoom voltage 24 to 240V AC/DC
- 2 change over contacts
- Width 22.5mm
- Industrial design



Technical data

1. Functions

Ip	Asymmetric flasher pause first
li	Asymmetric flasher pulse first
ER	ON delay and OFF delay with control contact
EWu	ON delay single shot leading edge voltage controlled
EWs	ON delay single shot leading edge with control contact
WsWa	Single shot leading and single shot trailing edge with control contact
Wt	Pulse sequence monitoring

2. Time ranges

Time range	Adjustment range	
1s	50ms	1s
3s	150ms	3s
10s	500ms	10s
30s	1500ms	30s
1min	3s	1min
3min	9s	3min
10min	30s	10min
30min	90s	30min
1h	3min	1h
10h	30min	10h

3. Indicators

Green LED U/t1 ON:	indication of supply voltage
Green LED U/t1 flashes:	indication of time period t1
Green LED t2 flashes:	indication of time period t2
Yellow LED ON/OFF:	indication of relay output

4. Mechanical design

Self-extinguishing plastic housing, IP rating IP40
 Mounted on DIN-Rail TS 35 according to EN 50022
 Mounting position: any
 Shockproof terminal connection according to VBG 4 (PZ1 required), IP rating IP20
 Tightening torque: max. 1Nm
 Terminal capacity:
 1 x 0.5 to 2.5mm² with/without multicore cable end
 1 x 4mm² without multicore cable end
 2 x 0.5 to 1.5mm² with/without multicore cable end
 2 x 2.5mm² flexible without multicore cable end

5. Input circuit

Supply voltage:	24 to 240V AC/DC	terminals A1-A2 (galvanically separated)
Tolerance:	24 to 240V DC	-20% to +25%
	24 to 240V AC	-15% to +10%
Rated frequency:	24 to 240V AC	48 to 400Hz
	48 to 240V AC	16 to 48Hz
Rated consumption:	4.5VA (1W)	
Duration of operation:	100%	
Reset time:	500ms	
Wave form for AC:	Sinus	
Residual ripple for DC:	10%	

Drop-out voltage: >15% of the supply voltage
 Overvoltage category: III (according to IEC 60661-1)
 Rated surge voltage: 4kV

6. Output circuit

2 potential free change over contacts
 Rated voltage: 250V AC
 Switching capacity (distance <5mm): 750VA (3A / 250V AC)
 Switching capacity (distance >5mm): 1250VA (5A / 250V AC)
 Fusing: 5A fast acting
 Mechanical life: 20 x 10⁶ operations
 Electrical Life: 2 x 10⁵ operations at 1000VA resistive load
 Switching frequency: max. 60/min at 100VA resistive load
 max. 6/min at 1000VA resistive load (according to IEC 947-5-1)
 Overvoltage category: III (according to IEC 60664-1)
 Rated surge voltage: 4kV

7. Control contact

Activation: bridge Y1-Y2
 Potential free: yes, basic isolation against input and output circuit
 Loadable: no
 Control voltage: max. 5V
 Short circuit current: max. 1mA
 Line length: max. 10m
 Control pulse length: min. 50ms (except Wt function)
 min. 7ms (Wt function only)

8. Remote potentiometer (not included)

The internal potentiometer is de-activated when a remote potentiometer is connected !!!
 Connections: 1M Ω potentiometer (type RONDO R2), terminals Y2-Z1 resp. Y2-Z2
 Line type: twisted pair
 Control voltage: max. 5V
 Short circuit current: max. 5 μ A
 Line length: max. 5m

9. Accuracy

Base accuracy: \pm 1% (of maximum scale value) using 1M Ω remote potentiometer
 Frequency response: -
 Adjustment accuracy: \leq 5% (of maximum scale value) using 1M Ω remote potentiometer
 Repetition accuracy: <0.5% or \pm 5ms
 Voltage influence: -
 Temperature influence: \leq 0.01% / $^{\circ}$ C
 Pollution degree: 3 (according to IEC 664-1)

Technical data

10. Ambient conditions

Ambient temperature:	-25 to +55°C (according to IEC 68-1)
	-25 to +40°C (according to UL 508)
Storage temperature:	-25 to +70°C
Transport temperature:	-25 to +70°C
Relative humidity:	15% to 85%
	(according to IEC 721-3-3 class 3K3)


Pollution degree:	3 (according to IEC 664-1)
Vibration resistance:	10 to 55Hz 0.35mm (according to IEC 68-2-6)
Shock resistance:	15g 11ms (according to IEC 68-2-27)

Functions

The internal potentiometer is de-activated when a remote-potentiometer is connected !
The function has to be set before connecting the relay to the supply voltage.


Asymmetric flasher pause first (Ip)

When the supply voltage U is applied, the set interval t1 begins (green LED U/t1 flashes). After the interval t1 has expired (green LED U/t1 illuminated), the output relay R switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED t2 flashes). After the interval t2 has expired (green LED t2 not illuminated), the output relay switches into off-position (yellow LED not illuminated). The output relay is triggered at the ratio of t1:t2 until the supply voltage is interrupted.

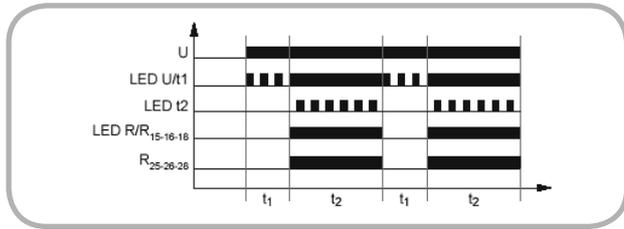


Asymmetric flasher pulse first (Ii)

When the supply voltage U is applied, the output relay R switches into on-position (yellow LED illuminated) and the set interval t1 begins (green LED U/t1 flashes). After the interval t1 has expired (green LED U/t1 illuminated), the output relay switches into off-position (yellow LED not illuminated) and the set interval t2 begins (green LED t2 flashes). After the interval t2 has expired (green LED t2 not illuminated), the output relay switches into on-position (yellow LED illuminated). The output relay is triggered at the ratio of t1:t2 until the supply voltage is interrupted.

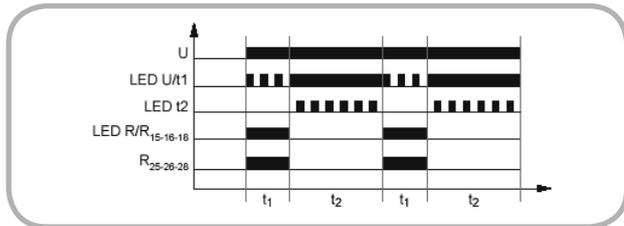


ON delay and OFF delay with control contact (ER)

The supply voltage U must be constantly applied to the device (green LED U/t1 illuminated).
When the control contact S is closed, the set interval t1 begins (green LED U/t1 flashes). After the interval t1 has expired (green LED U/t1 illuminated), the output relay R switches into on-position (yellow LED illuminated). If the control contact is opened, the set interval t2 begins (green LED t2 flashes). After the interval t2 has expired (green LED t2 not illuminated) the output relay switches into off-position (yellow LED not illuminated).
If the control contact is opened before the interval t1 has expired, the interval already expired is erased and is restarted with the next cycle.

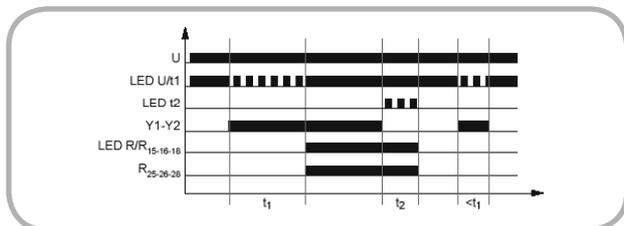


ON delay and single shot leading edge voltage controlled (EWu)

When the supply voltage U is applied, the set interval t1 begins (green LED U/t1 flashes). After the interval t1 has expired (green LED U/t1 illuminated), the output relay R switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED t2 flashes). After the interval t2 has expired (green LED t2 not illuminated), the output relay switches into off-position (yellow LED not illuminated).
If the supply voltage is interrupted before the interval t1+t2 has expired, the interval already expired is erased and is restarted when the supply voltage is next applied.

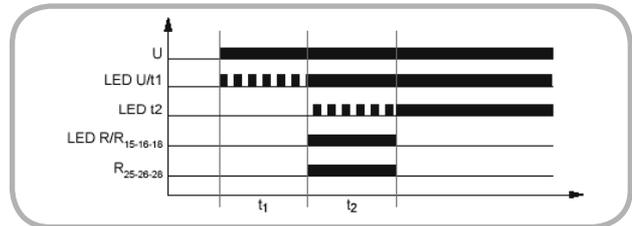


ON delay and single shot leading edge with control contact (EWs)

The supply voltage U must be constantly applied to the device (green LED U/t1 illuminated).
When the control contact S is closed, the set interval t1 begins (green LED U/t1 flashes). After the interval t1 has expired (green LED U/t1 illuminated), the output relay R switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED t2 flashes). After the interval t2 has expired (green LED t2 not illuminated) the output relay switches into off-position (yellow LED not illuminated).
During the interval, the control contact can be operated any number of times.
A further cycle can only be started when the cycle run has been completed.

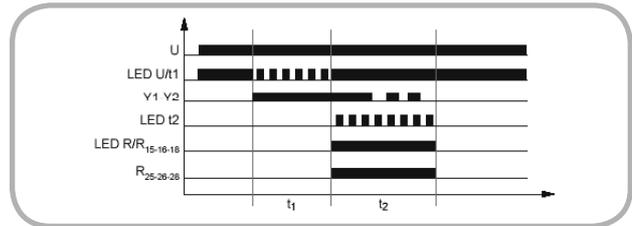

Single shot leading and single shot trailing edge with control contact (WsWa)

The supply voltage U must be constantly applied to the device (green LED U/t1 illuminated).
When the control contact S is closed, the output relay R switches into on-position (yellow LED illuminated) and the set interval t1 begins (green LED U/t1 flashes). After the interval t1 has expired (green LED U/t1 illuminated), the output relay R switches into off-position (yellow LED not illuminated).
If the control contact is opened, the output relay again switches into on-position (yellow LED illuminated) and the set interval t2 begins (green LED t2 flashes). After the interval t2 has expired (green LED t2 not illuminated) the output relay switches into off-position (yellow LED not illuminated).
During the interval, the control contact can be operated any number of times.

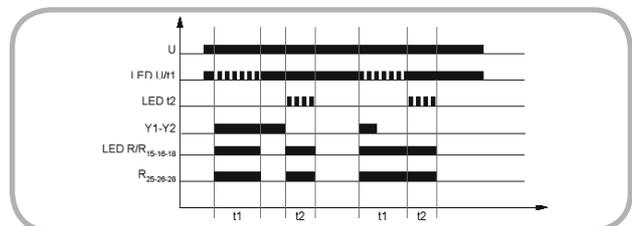


Functions

Pulse sequence monitoring (Wt)


When the supply voltage U is applied, the set interval t_1 begins (green LED U/t_1 flashes) and the output relay R_1 (15-16-18) switches into on-position (yellow LED illuminated).

After the interval t_1 has expired (green LED U/t_1 illuminated), the set interval t_2 begins (green LED t_2 flashes). So that the output relay R_1 remains in on-position, the control contact must be closed and opened again within the set interval t_2 . If this does not happen, the output relay R_1 switches into off-position (yellow LED not illuminated) and the output relay R_2 (25-26-28) switches into on-position. All further pulses at the control contact are ignored.


To restart the function the supply voltage must be interrupted and re-applied.

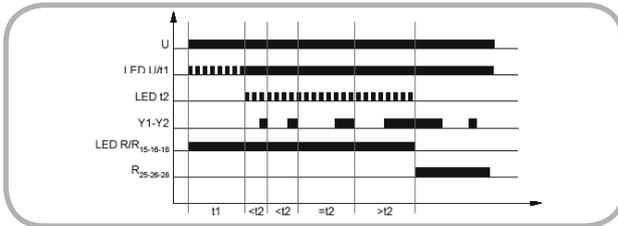

Connections

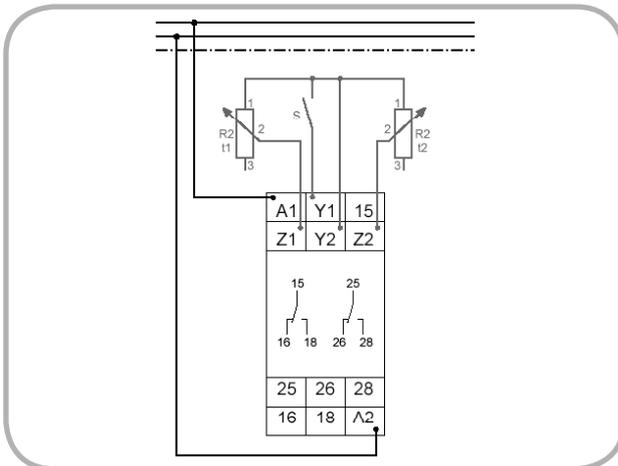

Dimensions

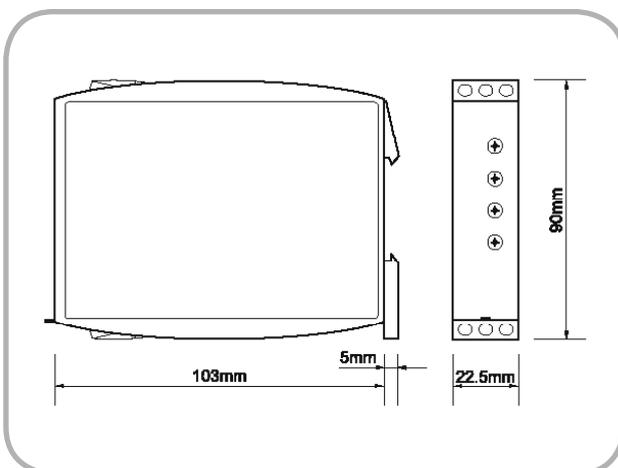

G2ZIF20 24-240V

 **Notes**

Subject to alterations and errors